





## MULTIsys Alarm Control Module Part No. MS200

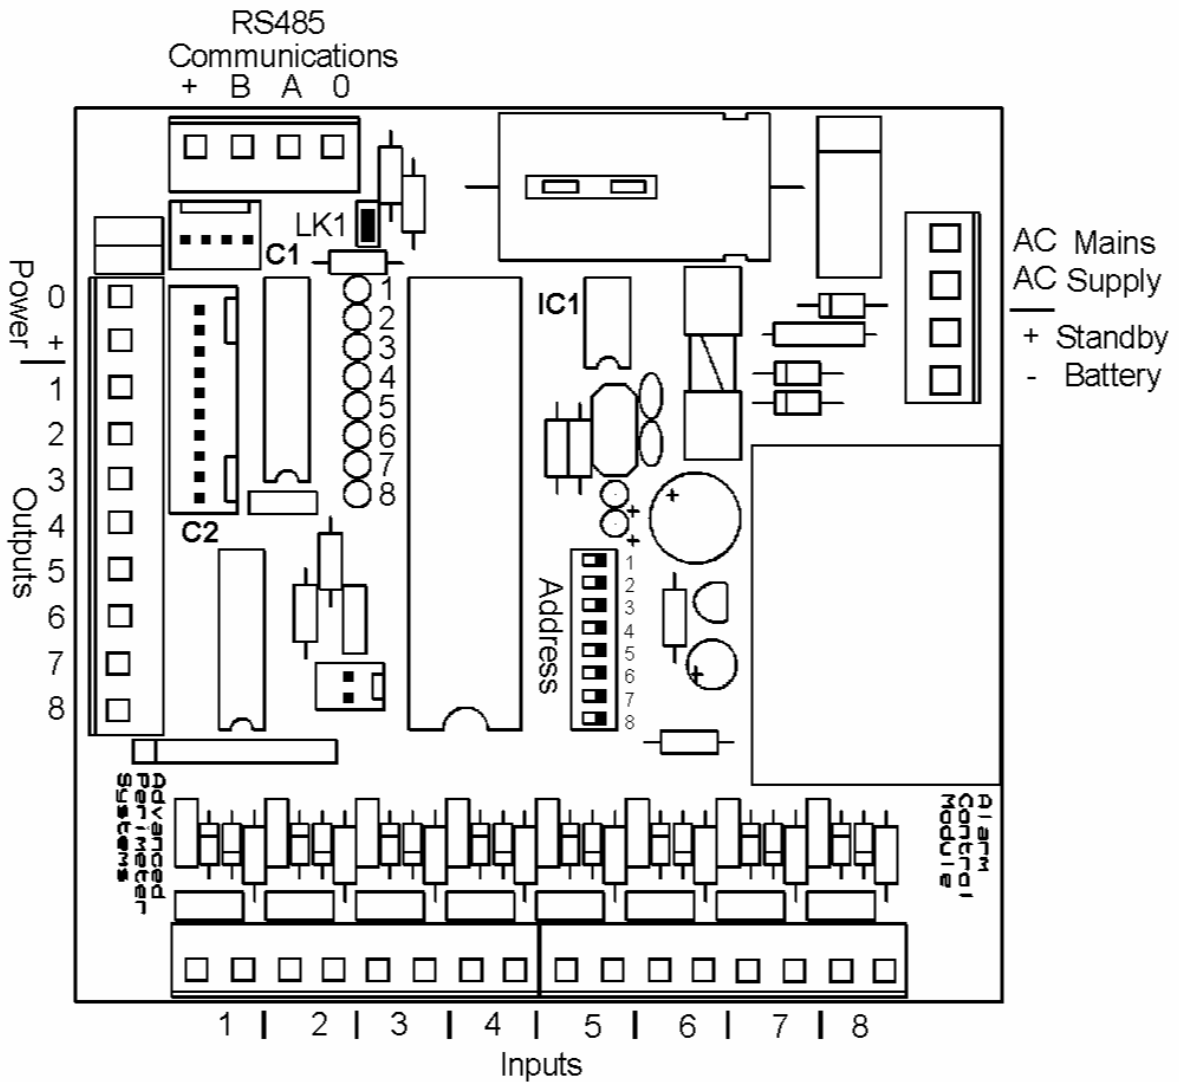

### Supervised Inputs

Each input must be terminated with a 5K6 resistor and a 22K resistor as shown below

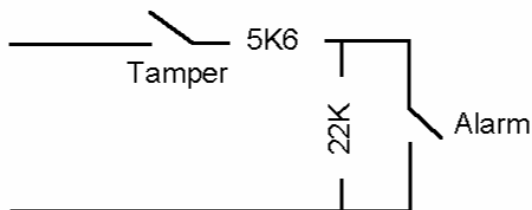

Note. Relays should be normally closed

### ACM Address Switch

1	2	3	4	5	6	7	8	Address
1	0	0	0	0	0	0	0	ACM #1
0	1	0	0	0	0	0	0	ACM #2
1	1	0	0	0	0	0	0	ACM #3
0	0	1	0	0	0	0	0	ACM #4
1	0	1	1	1	1	1	1	ACM #253